

प्रदीपक

भाग 5 विवरणात्मक अपेक्षाएँ

अनुभाग 2 रिसेस्ड प्रदीपक और रिसेस्ड वायु-हैंडलिंग प्रदीपक

(दूसरा पुनरीक्षण)

Luminaires

Part 5 Particular Requirements

Section 2 Recessed Luminaires and Recessed Air-Handling Luminaires

(Second Revision)

ICS 29.140.50

© BIS 2026

© IEC 2023



Follow us @



भारतीय मानक ब्यूरो

BUREAU OF INDIAN STANDARDS

मानक भवन, 9 बहादुर शाह ज़फर मार्ग, नई दिल्ली - 110002

MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI - 110002

www.bis.gov.in www.standardsbis.in

February 2026

Price Group 8

NATIONAL FOREWORD

This Indian Standard (Part 5/Sec 2) (Second Revision) which is identical to IEC 60598-2-2 : 2023 'Luminaires — Part 2-2: Particular requirements — Recessed luminaires and recessed air-handling luminaires' issued by the International Electrotechnical Commission (IEC) was adopted by the Bureau of Indian Standards on the recommendation of the Illumination Engineering and luminaires Sectional Committee and approval of the Electrotechnical Division Council.

This standard was first published in year 1985 and subsequently revised in year 2012 to align it with the IEC 60598-2-2 : 1997. This revision has been bought out to align it with IEC 60598-2-2 : 2023.

This revision includes the following significant technical changes with respect to the previous version:

- a) The requirements specific to recessed luminaires given in IS 10322 (Part 1) are now incorporated in this IS 10322 (Part 5/Sec 2);
- b) The introduction of requirements for air-handling luminaires; and
- c) References to IS 10322 (Part 1) have been updated.

This standard covers the safety and photometric requirements of recessed luminaires.

This standard is one among the series of Indian Standards which deals with luminaires. This series consists of the following parts and sections:

Part 1	General requirements
Part 5	Particular requirements,
Sec 1	Fixed general purpose luminaires
Sec 3	Luminaires for road and street lighting
Sec 4	Portable general purpose luminaires
Sec 5	Floodlights
Sec 6	Handlamps
Sec 7	Lighting chains
Sec 8	Luminaires for emergency lighting
Sec 18	Luminaires for swimming pools and similar applications

This standard is to be read in conjunction with IS 10322 (Part 1) 'Luminaires: Part 1 General requirements'. For the sake of convenience, the clauses of this standard correspond to those of IS 10322 (Part 1), instead of reproducing full text of each clause; reference to relevant clauses of IS 10322 (Part 1) has been given.

The text of the IEC standard has been approved as suitable for publication as an Indian Standard without deviations. Certain conventions are, however, not identical to those used in Indian Standards. Attention is particularly drawn to the following:

- a) Wherever the words 'International Standard' appears referring to this standard, they should be read as 'Indian Standard'; and
- b) Comma (,) has been used as a decimal marker, while in Indian Standards the current practice is to use a point (.) as the decimal marker.

[\(Continued on third cover\)](#)

CONTENTS

2.1 Scope	1
2.2 Normative references	1
2.3 Terms and definitions	1
2.4 General test requirements	2
2.5 Classification of luminaires	2
2.6 Marking	2
2.7 Construction	3
2.8 Creepage distances and clearances	3
2.9 Provision for earthing	3
2.10 Terminals	3
2.11 External and internal wiring	3
2.12 Protection against electric shock	3
2.13 Endurance tests and thermal tests	4
2.14 Resistance to dust and moisture	4
2.15 Insulation resistance and electric strength	5
2.16 Resistance to heat, fire and tracking	5
Annex A (normative) Measurement of ambient temperature in an installation	6
Annex B (normative) Recessed luminaires thermal test methods	7
Annex C (informative) Explanation of t_a with respect to air-handling luminaires	10
Annex D (informative) Schedule of amended subclauses containing more serious or critical requirements which require products to be retested	11
Bibliography	12
Figure 1 – Symbol for luminaires not suitable for direct mounting on normally flammable surfaces (suitable only for mounting on non-combustible surfaces)	2
Figure 2 – Symbol for luminaires not suitable for covering with thermally insulating material	3
Figure B.1 – Example of test recess where a luminaire suitable for covering with thermal insulating material comprises separate parts	7
Figure B.2 – Example of test recess where a luminaire not suitable for covering with thermal insulating material comprises separate parts	8
Figure B.3 – Correct test box size (insulating ceilings) for settable and adjustable luminaires	9
Table 1 – Operating temperature of cable	8

Indian Standard

LUMINAIRES

PART 5 PARTICULAR REQUIREMENTS

SECTION 2 RECESSED LUMINAIRES AND RECESSED AIR-HANDLING LUMINAIRES

(*Second Revision*)

2.1 Scope

This part of IEC 60598 specifies requirements for recessed luminaires incorporating electric light sources for operation from supply voltages up to 1 000 V. It also specifies requirements for recessed air-handling luminaires for use with a ventilation duct or ventilated space (plenum).

NOTE The expressions "ventilation" and "ventilated" in this document refer to forced ventilation.

2.2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60227 (all parts), *Polyvinyl chloride insulated cables of rated voltages up to and including 450/750 V*

IEC 60245 (all parts), *Rubber insulated cables – Rated voltages up to and including 450/750 V*

IEC 60598-1, *Luminaires – Part 1: General requirements and tests*

2.3 Terms and definitions

For the purposes of this document, the terms and definitions given in Part 1 and the following apply.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

- IEC Electropedia: available at <https://www.electropedia.org/>
- ISO Online browsing platform: available at <https://www.iso.org/obp>

2.3.1

air-handling luminaire

luminaire specially designed for use in association with an air conditioning system

Note 1 to entry: The air can pass either through the lamp chamber or through separate passages.

Note 2 to entry: For an explanation of the significance of t_a as applied to air-handling luminaires, see Annex C.

2.3.2

static operation

operation of a luminaire when not handling either forced supply or extract air but permitting natural convection

2.4 General test requirements

The provisions of Section 0 of Part 1 apply. The tests described in each appropriate section of Part 1 shall be carried out in the order listed in this document.

A procedure measuring ambient temperature in an installation is given in Annex A.

NOTE Annex A provides additional information on how ambient temperature is considered within the recessed cavity area relative to the t_a marking of the luminaire.

2.5 Classification of luminaires

Luminaires shall be classified in accordance with the provisions of Section 2 of Part 1.

2.6 Marking

2.6.1 The provisions of Section 3 of Part 1 apply, together with the requirements of 2.6.2, 2.6.3 and 2.6.4.

The following information shall be distinctly and durably marked on the luminaire and be visible during installation or behind a cover or part which is removed during installation.

2.6.2 For recessed luminaires with two IP ratings, both ratings shall be visible during installation and it shall be obvious to which parts of the luminaire the ratings refer. The relevant information shall be provided even if the rating is IP20 or the lower rating is specified as ordinary.

2.6.3 Where applicable, the relevant symbol for recessed luminaires not suitable for direct mounting on normally flammable surfaces shall be distinctly and durably marked on the luminaire and be visible during installation or behind a cover or part which is removed during installation.

When marked, this symbol shall be explained on the luminaire or in the manufacturer's instructions provided with the luminaire.

The minimum size of the symbol shall be 25 mm for each side. See Figure 1.




Figure 1 – Symbol for luminaires not suitable for direct mounting on normally flammable surfaces (suitable only for mounting on non-combustible surfaces)

2.6.4 Where applicable, the relevant symbol for luminaires not suitable for covering with thermally insulated material shall be distinctly and durably marked on the luminaire and be visible during installation or behind a cover or part which is removed during installation.

When marked, this symbol shall be explained on the luminaire or in the manufacturer's instructions provided with the luminaire.

The minimum size of the symbol shall be 25 mm for each side. See Figure 2.



Figure 2 – Symbol for luminaires not suitable for covering with thermally insulating material

2.7 Construction

The provisions of Section 4 of Part 1 apply.

2.8 Creepage distances and clearances

The provisions of Section 11 of Part 1 apply.

2.9 Provision for earthing

The provisions of Section 7 of Part 1 apply.

2.10 Terminals

The provisions of Sections 14 and 15 of Part 1 apply.

2.11 External and internal wiring

The provisions of Section 5 of Part 1 apply, together with the following.

Flexible cables or cords used as a means of connection to the supply, when supplied by the luminaire manufacturer, shall be at least equal in their mechanical and electrical properties to those specified in the IEC 60227 series or the IEC 60245 series and shall be capable of withstanding without deterioration the highest temperature to which they can be exposed under normal conditions of use. Materials other than PVC and rubber are suitable if the above requirements are met.

Compliance shall be checked by the tests specified in Clause 2.13.

NOTE The use of flexible cables and cords with recessed luminaires is appropriate for the following reasons:

- 1) The flexible cable or cord cannot be easily touched as it is normally out of reach within the recess.
- 2) To facilitate installation of the luminaire into the recess.
- 3) To permit the adjustment of settable and adjustable recessed luminaires.

2.12 Protection against electric shock

The provisions of Section 8 of Part 1 apply, together with the following.

The parts of the luminaire and components within the ceiling space or cavity shall provide the same degree of protection against electric shock as the luminaire parts below the ceiling space.

NOTE The ceiling space or cavity is regarded as accessible for installation and maintenance, and the barriers do not provide adequate protection against electric shock.

Compliance is checked by inspection.

2.13 Endurance tests and thermal tests

2.13.1 The provisions of Section 12 of Part 1 apply, together with the following requirements.

2.13.2 The luminaire shall be mounted and tested according to Annex B.

Luminaires with an IP classification greater than IP20 shall be subjected to the relevant tests of Clauses 12.4, 12.5, 12.6 and 12.7 of Section 12 of Part 1 after the test(s) of Clause 9.2 but before the test(s) of Clause 9.3 of Section 9 of Part 1 specified in Clause 2.14 of this document.

2.13.3 Wiring, for connection to the supply, which passes into or can touch the luminaire, shall not reach an unsafe temperature.

Compliance shall be checked by the following tests:

The luminaire is connected to the supply using the cable provided with the luminaire or using a cable in accordance with the marking on the luminaire or, if not marked, as specified in the manufacturer's instruction sheet; otherwise PVC cable complying with the IEC 60227 series is used.

The hottest point is found (along the internal route or on the outer surface of the luminaire) with which the cable is likely to lie in contact during normal service. The cable is lightly held in contact at this point and the temperature of the insulation at the point of contact is measured as described in Annex K of Part 1.

The operating temperature of the cable shall not exceed the limits given in Table 1.

Table 1 – Operating temperature of cable

Designation of cable	Limit of operating temperature
Cable (including sleeves) provided with the luminaire	The maximum temperature specified in Table 12.2 of Part 1
Cable not provided with the luminaire:	
a) luminaires with cable temperature marking	The marked temperature
b) luminaires without cable temperature marking	The maximum temperature specified in Table 12.2 of Part 1 for ordinary PVC not subject to mechanical stress

2.13.4 The test for air-handling luminaires is made under static operating conditions.

When testing air-handling luminaires with stubs for connection of ventilation ducts, the stubs are suitably connected to the sides or to the top of the test box according to the installation instructions.

- a) Normal operating conditions: During the test, the temperature of upward facing surfaces within the main air path shall not exceed 100 °C, except that for surfaces of light sources, the temperature shall not exceed 150 °C.
- b) Abnormal operating conditions: The temperature of the convection air when leaving the luminaire shall not exceed 100 °C. During the test, the temperature of upward facing surfaces within the main air path shall not exceed 130 °C except that for surfaces of light sources, the temperature shall not exceed 150 °C.

2.14 Resistance to dust and moisture

2.14.1 The provisions of Section 9 of Part 1 apply, as well as the following.

2.14.2 For luminaires with an IP classification greater than IP20, the order of the tests specified in Section 9 of Part 1 shall be as specified in Clause 2.13 of this document.

2.14.3 For recessed luminaires, the parts in the recess and the parts protruding from the recess shall each be tested according to their IP classification as indicated in the manufacturer's mounting instructions. A box encapsulating the part in the recess can be necessary.

NOTE The claimed IP rating is only applicable to the enclosure of the luminaire. In the case of a recessed luminaire, the IP rating of the luminaire does not protect the integrity of any seals outside of the luminaire, e.g. between the lower and upper parts of the ceiling.

2.15 Insulation resistance and electric strength

The provisions of Section 10 of Part 1 apply.

2.16 Resistance to heat, fire and tracking

The provisions of Section 13 of Part 1 apply.

Annex A (normative)

Measurement of ambient temperature in an installation

Care is needed in deciding whether a recessed luminaire is operating within its thermal limits in an existing lighting installation. It is even more difficult to predict whether a luminaire will be satisfactory in a proposed installation and a "mock-up" is usually required. In the past, there have been instances of overheating of luminaires, for example, overheating owing to the presence of heating services above the ceiling plane.

The following procedure is for measuring the ambient temperature in which the luminaire operates. The t_a rating of the luminaire should be at least equal to this ambient temperature. The ambient temperature is measured in the plane of the ceiling (or other mounting surface) at the mid-point of a typical cavity. It is important that all other luminaires in the installation and all other services which can affect the thermal conditions of the luminaire are operating. The cavity is covered above the measuring point to prevent a non-typical interchange of air and so that the cover can absorb extraneous heat which would be absorbed by the luminaire.

NOTE It can be convenient to insert for this purpose the shell of the luminaire.

The test recess used to measure operating temperatures of recessed luminaires is intended to represent the most onerous closed recess (without other heat source) which is likely to be experienced in service. A recessed luminaire should not be installed in a cavity with a volume smaller than that of the test recess, unless the manufacturer of the luminaire has verified that operation will be satisfactory.

The test recess can also approximate to the thermal conditions above a suspended ceiling if the larger air volume is offset by heat-emitting services. In a particular installation, more onerous thermal conditions than this can exist and it is, therefore, essential to carry out a practical check. Conversely, the space above the ceiling can have free air movement and no heat-emitting services; for such an installation, the t_a rating of the luminaire as determined in the test recess incorporates a temperature margin and the t_a rating may be exceeded if the manufacturer of the luminaire has verified that operation in the particular installation will be satisfactory.

During tests, to determine or check a t_a rating for a luminaire, measurements of ambient temperature are made inside the draught-proof enclosure and outside the test recess in accordance with Annex K of Part 1.

Annex B (normative)

Recessed luminaires thermal test methods

The requirements of Annex D of Part 1 are applicable with the following additional requirements.

Recessed luminaires suitable for covering with thermal insulating material are mounted in a test recess consisting of a suspended ceiling and thermal insulation material positioned in direct contact with the luminaire.


Recessed luminaires not suitable for covering with thermal insulating material are mounted in a test recess consisting of a suspended ceiling, on top of which is a rectangular box with vertical sides and horizontal top.

The suspended ceiling is made of a 12 mm thick general use particle board, in which a suitable opening has been made for the luminaire. The general use particle board shall extend at least 100 mm outside the projection of the luminaire on this board.

NOTE 1 An example of general used particle board is boards manufactured according to ISO 16893.

a) Luminaires for recessing into ceilings with thermal insulating material covering the luminaire

Thermal insulating material is tightly fitted to the outside of the luminaire. The thermal insulation shall be equivalent to two 10 cm thick layers of mineral wool with a coefficient of thermal resistivity of $0,04 \text{ W}/(\text{m} \cdot \text{K})$. Thinner layers can be used when having a higher thermal resistivity. If a luminaire is provided with separate parts intended for recessed mounting, (for example, with separate light source enclosure and controlgear enclosure), the test recess shall be constructed observing the manufacturer's recommendations for minimum spacing between parts (see Figure B.1). The space shall be filled with insulating material.

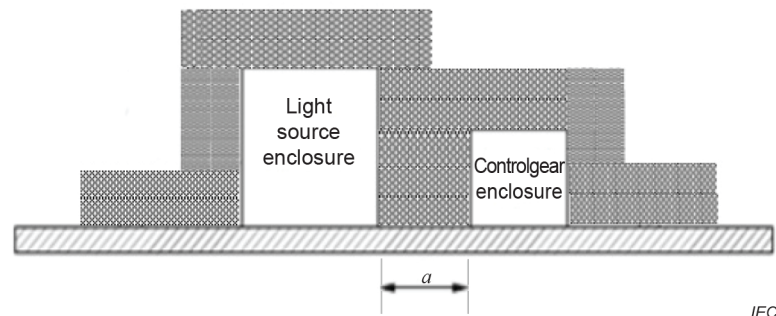

Key

a minimum separation as specified by the manufacturer


Figure B.1 – Example of test recess where a luminaire suitable for covering with thermal insulating material comprises separate parts

b) Luminaires for recessing into ceilings but not suitable for covering with thermal insulating material.

For recessed luminaires of this kind, the test recess consisting of a suspended ceiling, on top of which is a rectangular box with vertical sides and horizontal top, shall be fixed above the luminaire. The vertical sides of the box are made of 19 mm thick laminated wood and the top of 12 mm thick general use particle board tightly sealed to the sides.

The sides and top of the box shall be spaced from the luminaire in accordance with the manufacturer's instructions supplied with the luminaire. If no spacing is specified, the sealed box shall touch the luminaire all around.

If a luminaire is provided with separate parts intended for recessed mounting, (for example, with separate light source enclosure and controlgear enclosure), the test recess shall be constructed as a single box observing the manufacturer's recommendations for minimum spacing between parts and the inside of the recess (see Figure B.2). Where spacing between parts is not specified (item 'a' of Figure B.2), separate test recesses shall be used for each part.

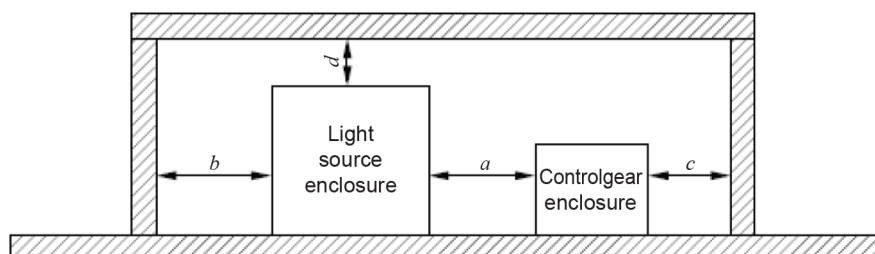

IEC

Key

a, b, c, d minimum separation as specified by the manufacturer

Figure B.2 – Example of test recess where a luminaire not suitable for covering with thermal insulating material comprises separate parts

If there are projecting spacers on the top or sides of the luminaire, then these spacers shall be placed in direct contact with the inside surfaces of the test box or insulating material.

The suspended ceiling and the interior of the box are painted black with a matt non-metallic paint, and there shall be a gap of not less than 100 mm between this assembly and the inside walls, ceiling and floor of the test enclosure.

NOTE 2 In Australia and New Zealand recessed luminaires are classified and tested for installations with thermal insulation in accordance with AS/NZS 60598-2-2, Particular requirements – Recessed Luminaires.

NOTE 3 It is acceptable in Japan to apply this Annex B or JIL 5002 for the thermal test on recessed luminaires.

When a luminaire is intended to be recessed into a wall, the test is made using a test recess similar to that described above, but with the board placed vertically.


For luminaires classified for mounting in direct contact with a normally flammable surface and suitable for covering with thermal insulating material, no part of the insulating material and the luminaire surface above the suspended ceiling shall exceed 90 °C during the normal operation thermal test and 130 °C during the abnormal operation thermal test.

For luminaires classified for mounting in direct contact with a normally flammable surface not suitable for covering with thermal insulating material, no part of the test recess shall exceed 90 °C during the normal operation thermal test and 130 °C during the abnormal operation thermal test.

For luminaires classified as not suitable for direct mounting on normally flammable surfaces, no temperatures are measured for the mounting surface or test recess.

All spacings shall be measured from the extremes of the positions of movement where luminaires are settable and adjustable in overall dimension or position in either axis when fully installed and during normal operation (see Figure B.3).

Figure B.3 illustrates the correct test box size for a luminaire that is adjustable in both axes and thus needs space within a ceiling for the setting or the adjustment.

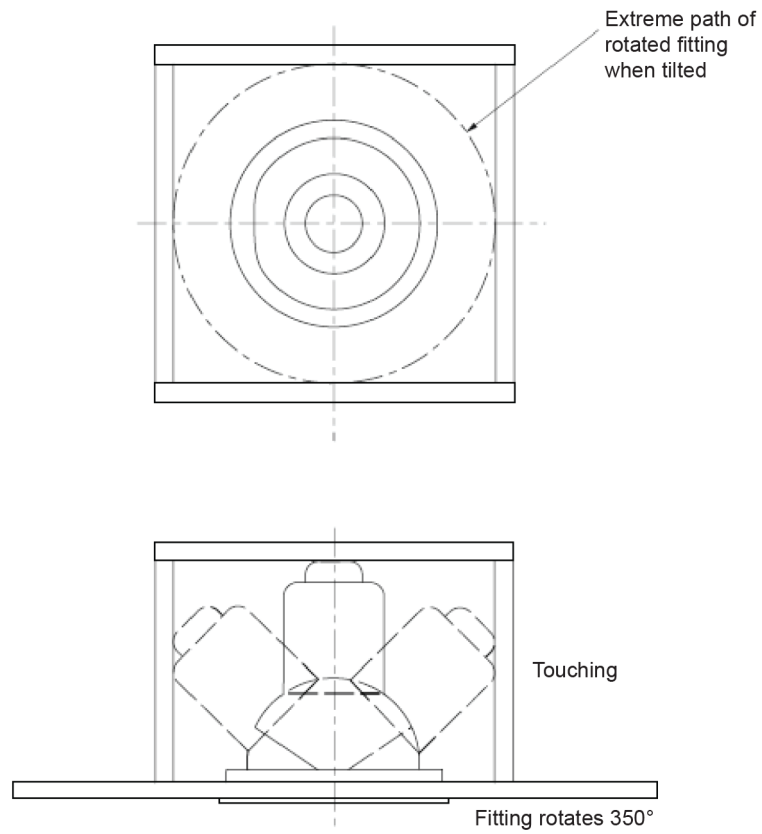

IEC

Figure B.3 – Correct test box size (insulating ceilings) for settable and adjustable luminaires

Annex C (informative)

Explanation of t_a with respect to air-handling luminaires

"Rated maximum ambient temperature" (symbol: t_a) is defined in Part 1 and the definition includes the phrase "under normal conditions". In the case of an air-handling luminaire, "normal conditions" depend on the type of air-conditioning system with which the luminaire is associated, and it is therefore necessary to specify a set of conditions under which t_a will be measured and to draw attention to the relationship between these conditions and those which can occur in practice.

The conditions specified in this document are those associated with static operation, that is when the luminaire is not handling forced supply or extract air, but permitting normal convection air flow, and the t_a to be marked on the luminaire is the maximum ambient temperature in which the luminaire will operate under these conditions.

When the luminaire is installed as part of an air conditioning system, however, the ambient temperature in the vicinity of the luminaire depends on the type and characteristics of the system, and these can be assessed only by the user.

For this assessment, the temperature should be measured at the mid-point of the cavity in which the luminaire will be mounted, with a dummy or static luminaire in position to simulate restrictions which the luminaire can cause to free flow.

In order to simulate the worst conditions which can arise in forced air-flow systems, the air-circulation system should be switched off during temperature measurements on systems which either supply cooling air or extract air at room temperature, and switched on during measurements on systems supplying air above room temperature.

A luminaire chosen for use in this position should have a t_a at least as high as the measured temperature.

Annex D
(informative)

**Schedule of amended subclauses containing more serious or critical
requirements which require products to be retested**

No requirements of this document are considered more onerous compared with the previous edition of IEC 60598-2-2 and with IEC 60598-2-19.

Bibliography

IEC 60598-2-19, *Luminaires – Part 2-19: Particular requirements – Air-handling luminaires (safety requirements)*

ISO 16893, *Wood-based panels – Particleboard*

AS/NZS 60598-2-2, *Luminaires Particular requirements – Recessed Luminaires*

JIL 5002, *Recessed lighting fixture*

(Continued from second cover)

In this adopted standard, reference appears to International Standards for which Indian Standards also exists. The corresponding Indian Standards, which are to be substituted, are listed below along with their degree of equivalence for the editions indicated:

<i>International Standard</i>	<i>Corresponding Indian Standard</i>	<i>Degree of Equivalence</i>
IEC 60598-1 Luminaires — Part 1: General requirements and tests	IS 10322 (Part 1) : 2026 Luminaires: Part 1 General requirements and tests (<i>second revision</i>) (IEC 60958-1 : 2024, MOD)	Modified

The technical committee has reviewed the provision of the following International Standard referred in this adopted standard and has decided that it is acceptable for use in conjunction with this standard:

<i>International Standard</i>	<i>Title</i>
IEC 60227 (all parts)	Polyvinyl chloride insulated cables of rated voltages up to and including 450/750 V
IEC 60245 (all parts)	Rubber insulated cables — Rated voltages up to and including 450/750 V

Only English language text has been retained while adopting it in this Indian Standard, and as such the page numbers given here are not the same as in the International Standard.

For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated expressing the result of a test, shall be rounded off in accordance with IS 2 : 2022 'Rules for rounding off numerical values (*second revision*)'. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

Bureau of Indian Standards

BIS is a statutory institution established under the *Bureau of Indian Standards Act, 2016* to promote harmonious development of the activities of standardization, marking and quality certification of goods and attending to connected matters in the country.

Copyright

BIS has the copyright of all its publications. No part of these publications may be reproduced in any form without the prior permission in writing of BIS. This does not preclude the free use, in the course of implementing the standard, of necessary details, such as symbols and sizes, type or grade designations. Enquiries relating to copyright be addressed to the Head (Publication & Sales), BIS.

Review of Indian Standards

Amendments are issued to standards as the need arises on the basis of comments. Standards are also reviewed periodically; a standard along with amendments is reaffirmed when such review indicates that no changes are needed; if the review indicates that changes are needed, it is taken up for revision. Users of Indian Standards should ascertain that they are in possession of the latest amendments or edition by referring to the website- www.bis.gov.in or www.standardsbis.in.

This Indian Standard has been developed from Doc No.: ETD 49 (27113).

Amendments Issued Since Publication

Amend No.	Date of Issue	Text Affected

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, New Delhi 110002

Telephones: 2323 0131, 2323 3375, 2323 9402

Website: www.bis.gov.in

Regional Offices:

	Telephones
Central : 601/A, Konnectus Tower -1, 6 th Floor, DMRC Building, Bhavbhuti Marg, New Delhi 110002	{ 2323 7617
Eastern : 8 th Floor, Plot No 7/7 & 7/8, CP Block, Sector V, Salt Lake, Kolkata, West Bengal 700091	{ 2367 0012 2320 9474
Northern : Plot No. 4-A, Sector 27-B, Madhya Marg, Chandigarh 160019	{ 265 9930
Southern : C.I.T. Campus, IV Cross Road, Taramani, Chennai 600113	{ 2254 1442 2254 1216
Western : 5 th Floor/MTNL CETTM, Technology Street, Hiranandani Gardens, Powai Mumbai 400076	{ 25700030 25702715

Branches : AHMEDABAD, BENGALURU, BHOPAL, BHUBANESHWAR, CHANDIGARH, CHENNAI, COIMBATORE, DEHRADUN, DELHI, FARIDABAD, GHAZIABAD, GUWAHATI, HARYANA (CHANDIGARH), HUBLI, HYDERABAD, JAIPUR, JAMMU, JAMSHEDPUR, KOCHI, KOLKATA, LUCKNOW, MADURAI, MUMBAI, NAGPUR, NOIDA, PARWANOO, PATNA, PUNE, RAIPUR, RAJKOT, SURAT, VIJAYAWADA.